



Comhairle Cathrach
& Contae **Luimnigh**

Limerick City
& County Council

Air Quality Report for Limerick

August 2020

Introduction

Limerick City and County Council currently has air quality monitors operating at three locations in the metropolitan area of Limerick to provide live indicative air quality data to the public. These monitors are located in Mungret, Castletroy and O'Connell St.

The monitors measure particulate matter and gases, including nitrogen dioxide (NO₂), sulphur dioxide (SO₂), carbon monoxide (CO) and ozone. Real time data from these monitors can be accessed at www.airqweb.com.

The monitors were removed for calibration on February 6th 2020 and reinstalled on the 4th of March 2020. A replacement particulate matter monitor was installed in Mungret to allow for a continuation of data collection.

The particulate monitor on O'Connell St was removed on the 17th of July for repair and reinstalled on the 18th of August.

Particulate matter

Particulate matter (PM) which is commonly used as an indicator of dust particles in air, including total suspended particulates, PM₁₀, PM_{2.5} and PM₁.

PM₁₀ is particulate matter 10 microns or less in diameter, PM_{2.5} is particulate matter 2.5 microns or less in diameter and PM₁ is particulate matter 1 micron or less. PM_{2.5} is generally described as fine particulates. As a comparison, the width of a human hair is around 100 microns so approximately 40 PM_{2.5} will fit along its width.

The particulate matter indices that are of primary concern for human health are PM₁₀, PM_{2.5} and PM₁. These are the sub-fraction of particles, which can penetrate into the alveoli (air sacs) in the lungs. Chronic exposure to particles contributes to the risk of developing cardiovascular and respiratory diseases, as well as of lung cancer.

Nitrogen dioxide

Nitrogen dioxide (NO₂) is produced during combustion at high temperatures with the main sources in Ireland being vehicles and power stations. Short-term exposure to NO₂ is linked to adverse respiratory effects including airway inflammation in healthy people and increased respiratory symptoms in asthmatics. Long-term exposure is associated with increased risk of respiratory infections in children.

Sulphur dioxide

Sulphur dioxide (SO₂) is a gas, which is formed when sulphur-containing fuels (e.g. coal and oil) are burned in power stations, domestically and elsewhere. Impacts of high concentrations of SO₂ include temporary breathing difficulties for those that suffer from respiratory conditions such as asthma. Long-term exposure to SO₂ can aggravate existing cardiovascular disease and respiratory illness.

Carbon monoxide

Carbon monoxide (CO) is a colourless gas, formed from incomplete oxidation during combustion of fuel. Outdoor sources of CO are mainly from vehicles with concentrations generally highest in areas of traffic congestion. CO enters the bloodstream through the lungs and impairs the delivery of oxygen to the body's organs and tissues. The health impact of CO concentrations in ambient air is most serious for those suffering cardiovascular disease such as angina.

Ozone

Ozone (O₃) is formed as a secondary pollutant in the troposphere from the chemical reaction of NO_x (the two pollutants nitric oxide, NO, and nitrogen dioxide, NO₂), CO and volatile organic compounds (VOCs) in the presence of sunlight. Ozone can also be present in the troposphere due to downward flux from the ozone-rich stratosphere, where it occurs naturally and has a role in absorbing harmful UV radiation. Ground-level ozone is depleted through reactions with traffic-emitted pollutants and so levels of ozone are higher in rural areas than in urban areas.

Ozone irritates the eyes, nose, throat and lungs. It can destroy throat and lung tissue leading to a decrease in lung function and respiratory symptoms such as coughing, shortness of breath, aggravated asthma and other lung diseases.

Air Quality Standards

The CAFE (Clean Air for Europe) Directive sets air quality standards for member states in Europe and has been transposed into Irish legislation by the **Air Quality Standards Regulations**. The limit values for particulates are given below.

Pollutant	Objective	Averaging Period	Limit Value	Basis of Application of the Limit Value	Limit Value Attainment Date
PM ₁₀	Protection of human health	24-hours	50 µg/m ³	Not to be exceeded more than 35 times in a calendar year	1 Jan 2005
	Protection of human health	Calendar year	40 µg/m ³	Annual mean	1 Jan 2005
PM _{2.5}	Protection of human health	Calendar year	25 µg/m ³	Annual mean	1 Jan 2005
	Protection of human health	Calendar year	20 µg/m ³	Annual mean	1 Jan 2020
NO ₂	Protection of human health	1-hour	200 µg/m ³	Not to be exceeded more than 18 times in a calendar year	1 Jan 2010
	Protection of human health	Calendar year	40 µg/m ³	Not to be exceeded more than 18 times in a calendar year	1 Jan 2010
SO ₂	Protection of human health	1-hour	150 µg/m ³	Not to be exceeded more than 24 times in a calendar year	1 Jan 2005
	Protection of human health	24-hours	125 µg/m ³	Not to be exceeded more than 3 times in a calendar year	1 Jan 2005
CO	Protection of human health	Maximum 8-hour mean*	10mg/m ³	60% of the hourly running 8-hour averages	1 Jan 2005

**The maximum daily 8-hour mean concentration is selected by examining eight-hour running averages, calculated from hourly data.*

The World Health Organisation (WHO) provides air quality guidelines as follows:

Pollutant	Averaging period	Guideline
PM ₁₀	Calendar year	20 µg/m ³
	24-hours	50 µg/m ³
PM _{2.5}	Calendar year	10 µg/m ³
	24-hours	25 µg/m ³
NO ₂	Calendar year	40 µg/m ³
	1-hour	200 µg/m ³
SO ₂	24-hour	20 µg/m ³
	10-minutes	500 µg/m ³
Ozone	8-hour	100 µg/m ³

Air Quality in August

The graphs on the following pages show the 24 hourly mean values of Total Particulates, PM₁₀, PM_{2.5}, PM₁, NO₂, SO₂, CO and ozone for the month of August at the three monitoring sites. The monitoring results for particulate matter have been filtered out where the humidity at the station has been measured as greater than 85 %, as per a recommendation by the EPA¹. Humidity was greater than 85% at Castletroy on the 27th of August subsequently particulate matter results were filtered out for this date. The relevant air quality standards or WHO guideline values for PM₁₀, PM_{2.5}, NO₂, SO₂ and CO also indicated. There are no standards currently set for Total Particulates, PM₁ and ozone.

At the sites, the results for particulate matter and gases (NO₂, SO₂, CO and ozone) indicated generally good air quality throughout August.

Further information on air quality and health can be found at <http://www.epa.ie/air/quality/index/#d.en.51478>

The long term mean values for particulate matter and gases (NO₂, SO₂, CO and ozone) since the monitors were installed are shown in the table below and compared with the annual mean limits and guidelines.

¹ Limerick City and County Council included humidity and temperature sensors to the monitoring suite on 24th January 2018.

Parameter	Location	Measured long term mean ($\mu\text{g}/\text{m}^3$)	WHO annual mean guidelines ($\mu\text{g}/\text{m}^3$)	EU CAFÉ Directive annual mean limit ($\mu\text{g}/\text{m}^3$)
Total Particulates O Connell St August 18 th – August 31 st 2020 Castletroy March 4 th – August 2020 Mungret January – August 2020	O'Connell St	11 $\mu\text{g}/\text{m}^3$	None specified	None specified
	Castletroy	13 $\mu\text{g}/\text{m}^3$		
	Mungret	14 $\mu\text{g}/\text{m}^3$		
PM₁₀ O Connell St August 18 th – August 31 st 2020 Castletroy March 4 th – August 2020 Mungret January – August 2020	O'Connell St	8 $\mu\text{g}/\text{m}^3$	20 $\mu\text{g}/\text{m}^3$	40 $\mu\text{g}/\text{m}^3$
	Castletroy	9 $\mu\text{g}/\text{m}^3$		
	Mungret	9 $\mu\text{g}/\text{m}^3$		
PM_{2.5} O Connell St August 18 th – August 31 st 2020 Castletroy March 4 th – August 2020 Mungret January – August 2020	O'Connell St	6 $\mu\text{g}/\text{m}^3$	10 $\mu\text{g}/\text{m}^3$	20 $\mu\text{g}/\text{m}^3$
	Castletroy	5 $\mu\text{g}/\text{m}^3$		
	Mungret	6 $\mu\text{g}/\text{m}^3$		
PM₁ O Connell St August 18 th – August 31 st 2020 Castletroy March 4 th – August 2020 Mungret January – August 2020	O'Connell St	3 $\mu\text{g}/\text{m}^3$	None specified	None specified
	Castletroy	3 $\mu\text{g}/\text{m}^3$		
	Mungret	3 $\mu\text{g}/\text{m}^3$		
NO₂ March 4 th – August 2020 Castletroy O Connell St Mungret	O'Connell St	19 $\mu\text{g}/\text{m}^3$	40 $\mu\text{g}/\text{m}^3$	40 $\mu\text{g}/\text{m}^3$
	Castletroy	10 $\mu\text{g}/\text{m}^3$		
	Mungret	10 $\mu\text{g}/\text{m}^3$		
SO₂ March 4 th – August 2020 Castletroy O Connell St Mungret	O'Connell St	6 $\mu\text{g}/\text{m}^3$	None specified	20 $\mu\text{g}/\text{m}^3$
	Castletroy	5 $\mu\text{g}/\text{m}^3$		
	Mungret	5 $\mu\text{g}/\text{m}^3$		
CO March 4 th – August 2020 Castletroy O Connell St Mungret	O'Connell St	0.12 mg/m^3	None specified	None specified
	Castletroy	0.10 mg/m^3		
	Mungret	0.20 mg/m^3		
Ozone March 4 th – August 2020 Castletroy O Connell St Mungret	O'Connell St	49 $\mu\text{g}/\text{m}^3$	None specified	None specified
	Castletroy	52 $\mu\text{g}/\text{m}^3$		
	Mungret	47 $\mu\text{g}/\text{m}^3$		

The maximum daily mean values for particulate matter, for August, are shown in the table below and compared with the WHO air quality guidelines where they exist.

Pollutant	Total Particulates	PM ₁₀	PM _{2.5}	PM ₁
Averaging period	-	24-hours	24-hours	-
Guideline	None	50 µg/m ³	25 µg/m ³	None
Maximum August '20 O'Connell Street	20 µg/m ³ 20/08/20	15 µg/m ³ 20/08/20	13 µg/m ³ 20/08/20	7 µg/m ³ 20/08/20
Maximum August '20 Castletroy	27 µg/m ³ 10/08/20	18 µg/m ³ 10/08/20	10 µg/m ³ 20/08/20	5 µg/m ³ 20/08/20
Maximum August '20 - Mungret	19 µg/m ³ 23/08/20	15 µg/m ³ 23/08/20	11 µg/m ³ 20/08/20	7 µg/m ³ 20/08/20

There were no exceedances of WHO guideline values for the month of August.


The maximum recorded short-term mean values for gases (NO₂, SO₂ and ozone), for August, are shown in the table below and compared with the WHO air quality guidelines.

Pollutant	NO ₂	SO ₂	Ozone
Averaging period	1-hour	10-minutes ²	8-hours
Guideline	200 µg/m ³	500 µg/m ³	100 µg/m ³
Maximum August '20 - O'Connell Street	68 µg/m ³ 16:30-17:30, 14/08/20	187 µg/m ³ 12:15-12:30, 30/08/20	74 µg/m ³ 22:30-06:30, 20+21/08/20
Maximum August '20 – Castletroy	26 µg/m ³ 21:30-22:30, 26/08/20	49 µg/m ³ 21:30-21:45, 26/08/20	68 µg/m ³ 22:30-06:30, 20+21/08/20
Maximum August 20 - Mungret	25 µg/m ³ 08:30-09:30, 10/08/20	47 µg/m ³ 09:00-09:15, 24/08/20	63 µg/m ³ 22:30- 06:30, 20+21/08/20


There were no exceedances of WHO guideline values for the month of August.

² Measurements of SO₂ are averaged over 15-minute periods by the gas monitors. An exceedance is inferred where the measured 15-minutes average value from the gas monitors is greater than the 10-minutes WHO guideline value for SO₂.


Total Particulates - 24 hour mean ($\mu\text{g}/\text{m}^3$)

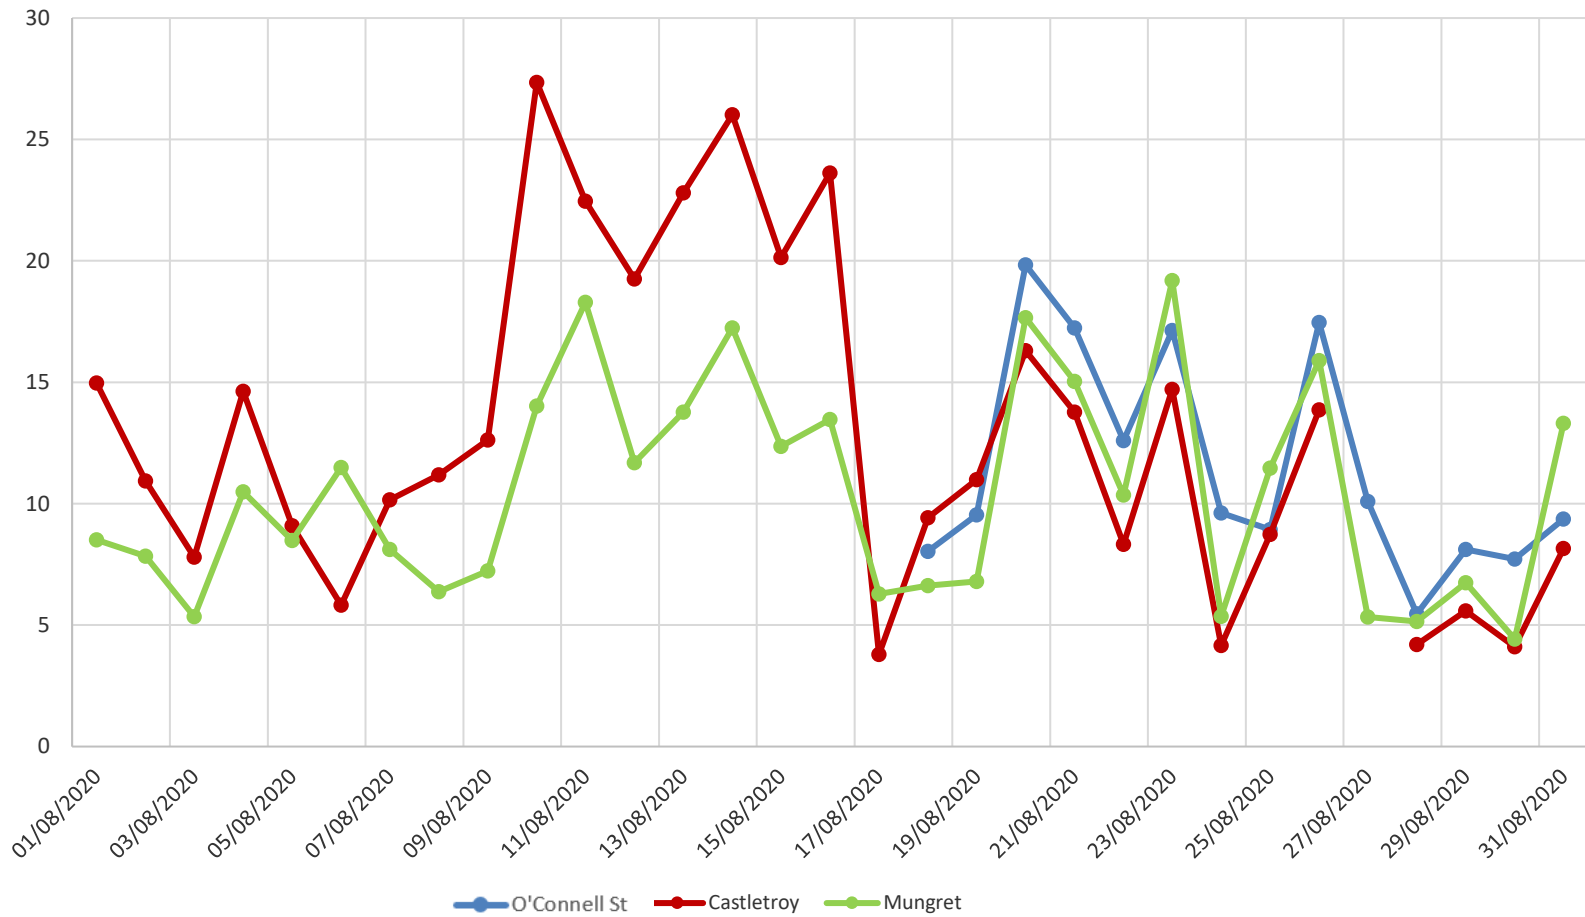


Particulate Matter < 10 microns (PM10) 24 hour mean ($\mu\text{g}/\text{m}^3$)

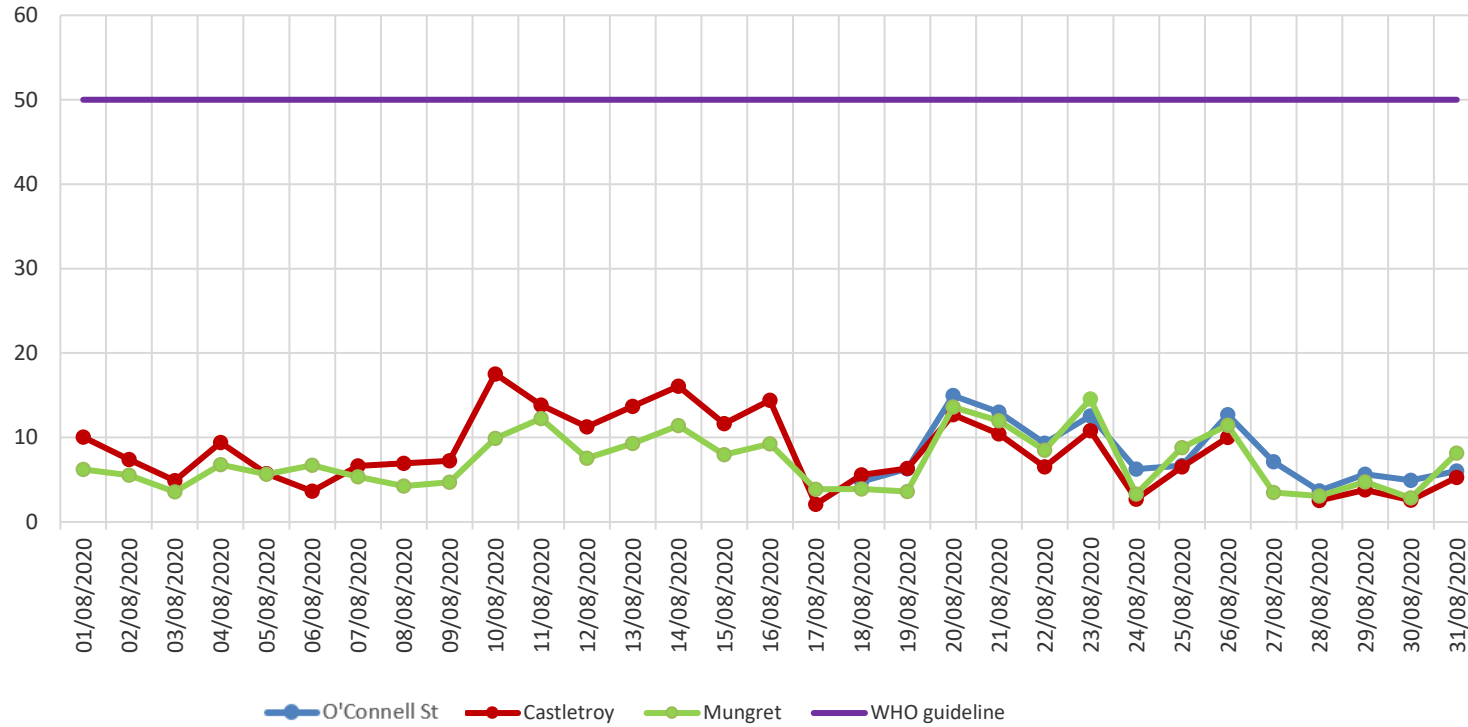


Particulate Matter < 2.5 micron (PM2.5) 24 hour mean ($\mu\text{g}/\text{m}^3$)

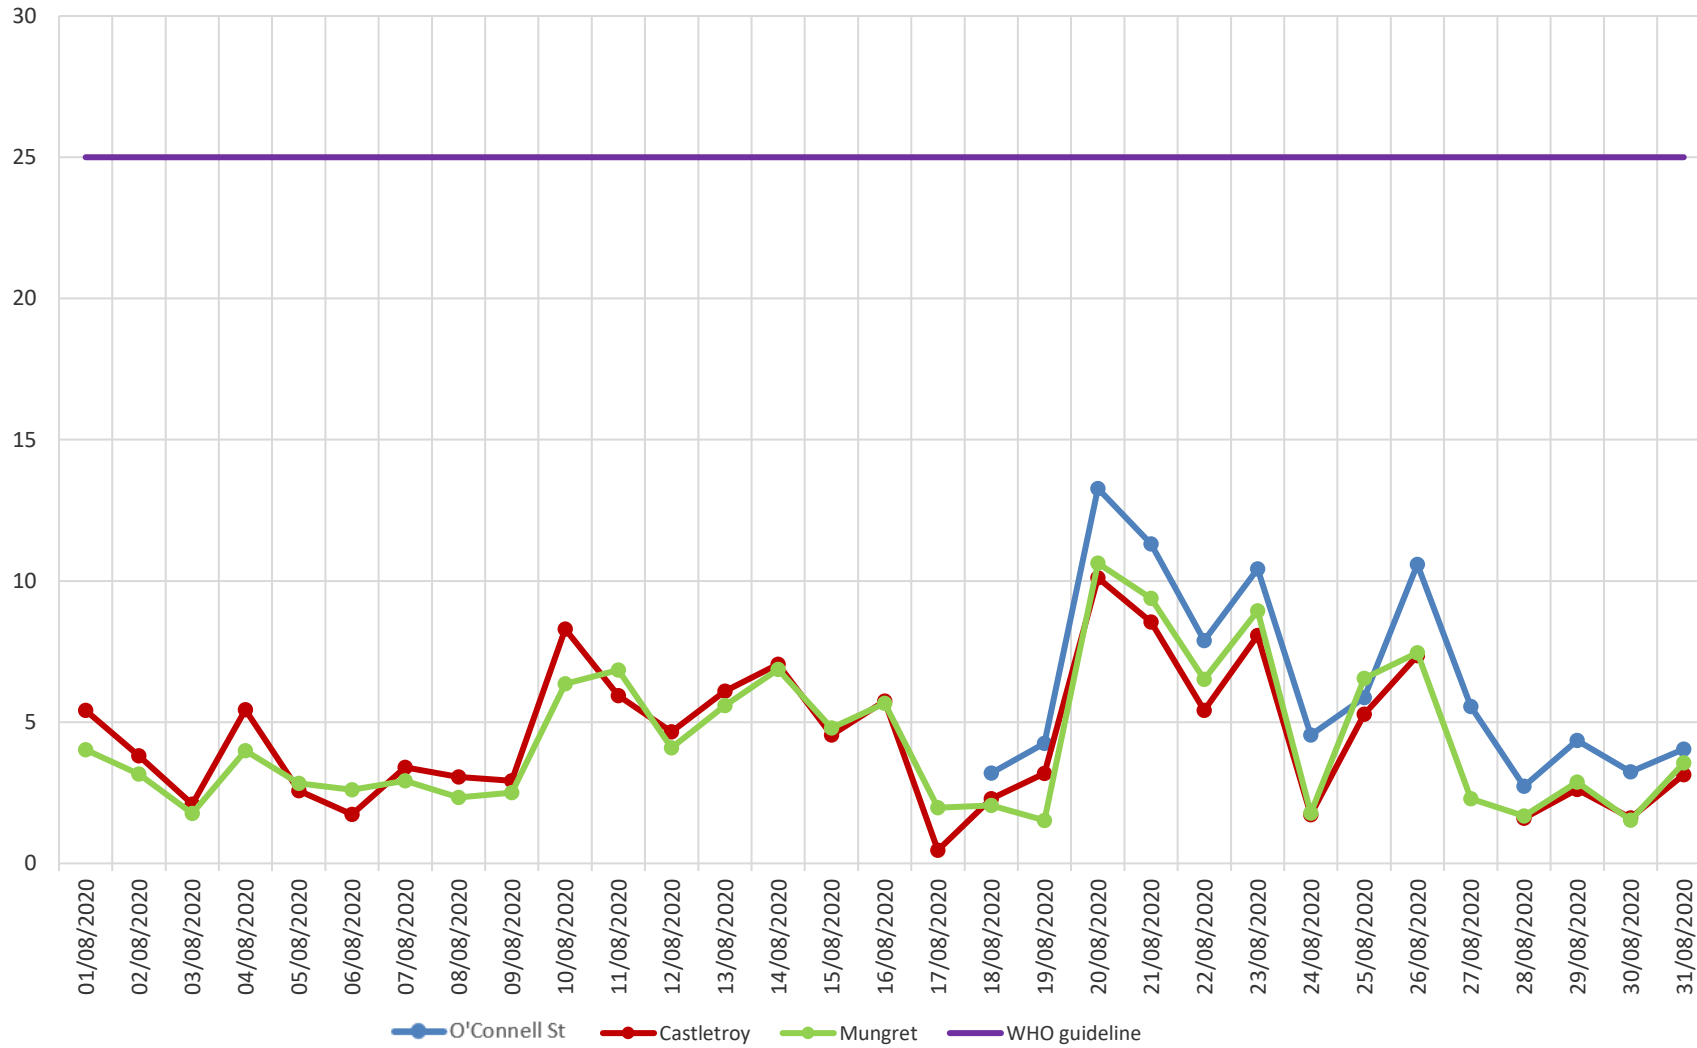


Particulate Matter < 1 micron (PM1) 24 hour mean ($\mu\text{g}/\text{m}^3$)

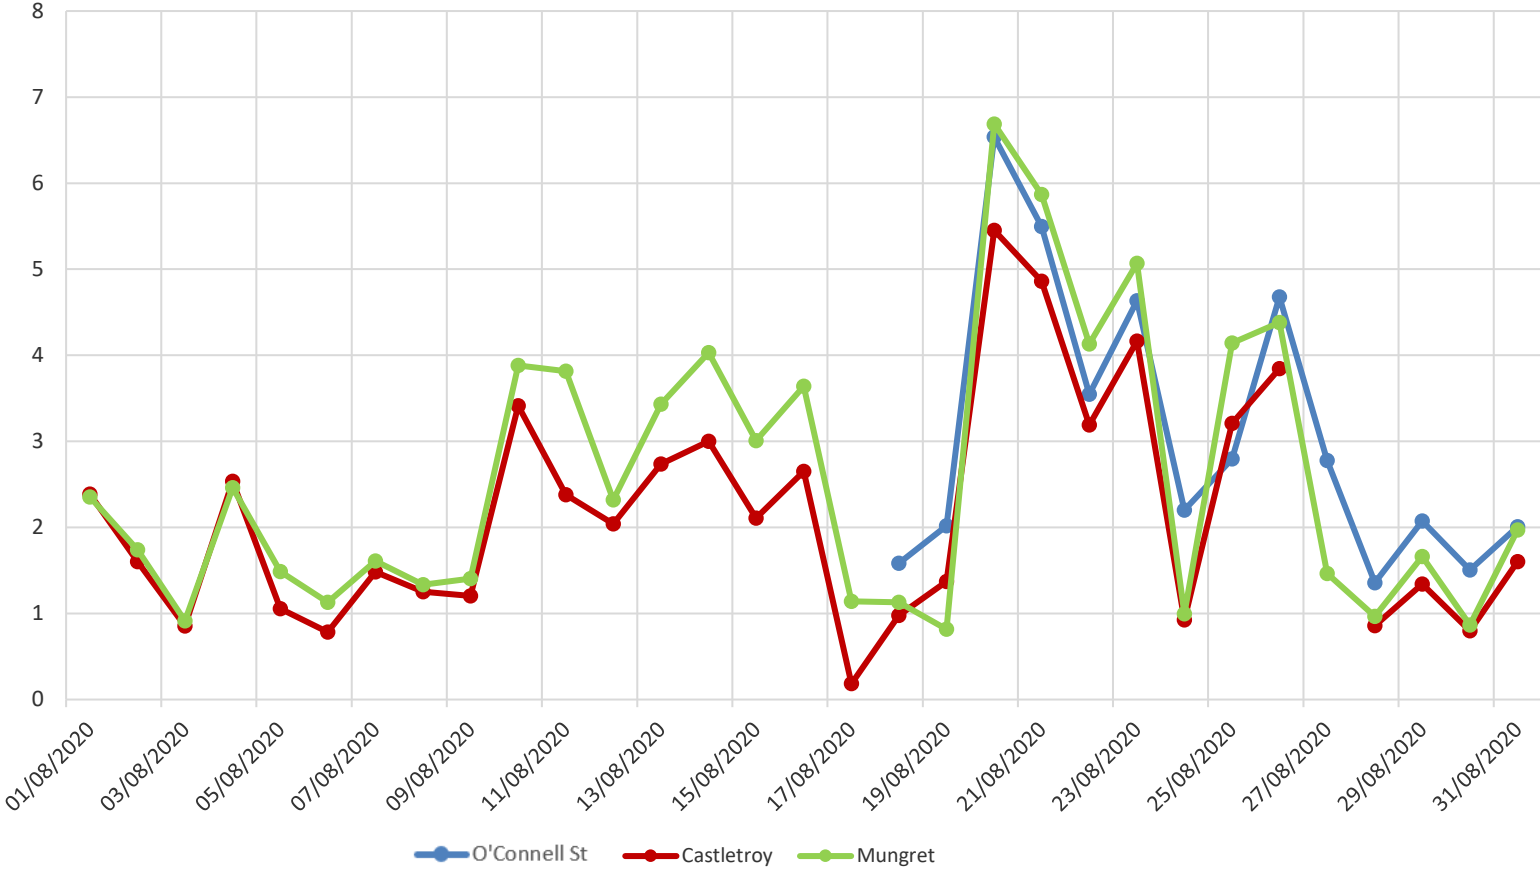


NO₂ - 24 hour mean (µg/m³)

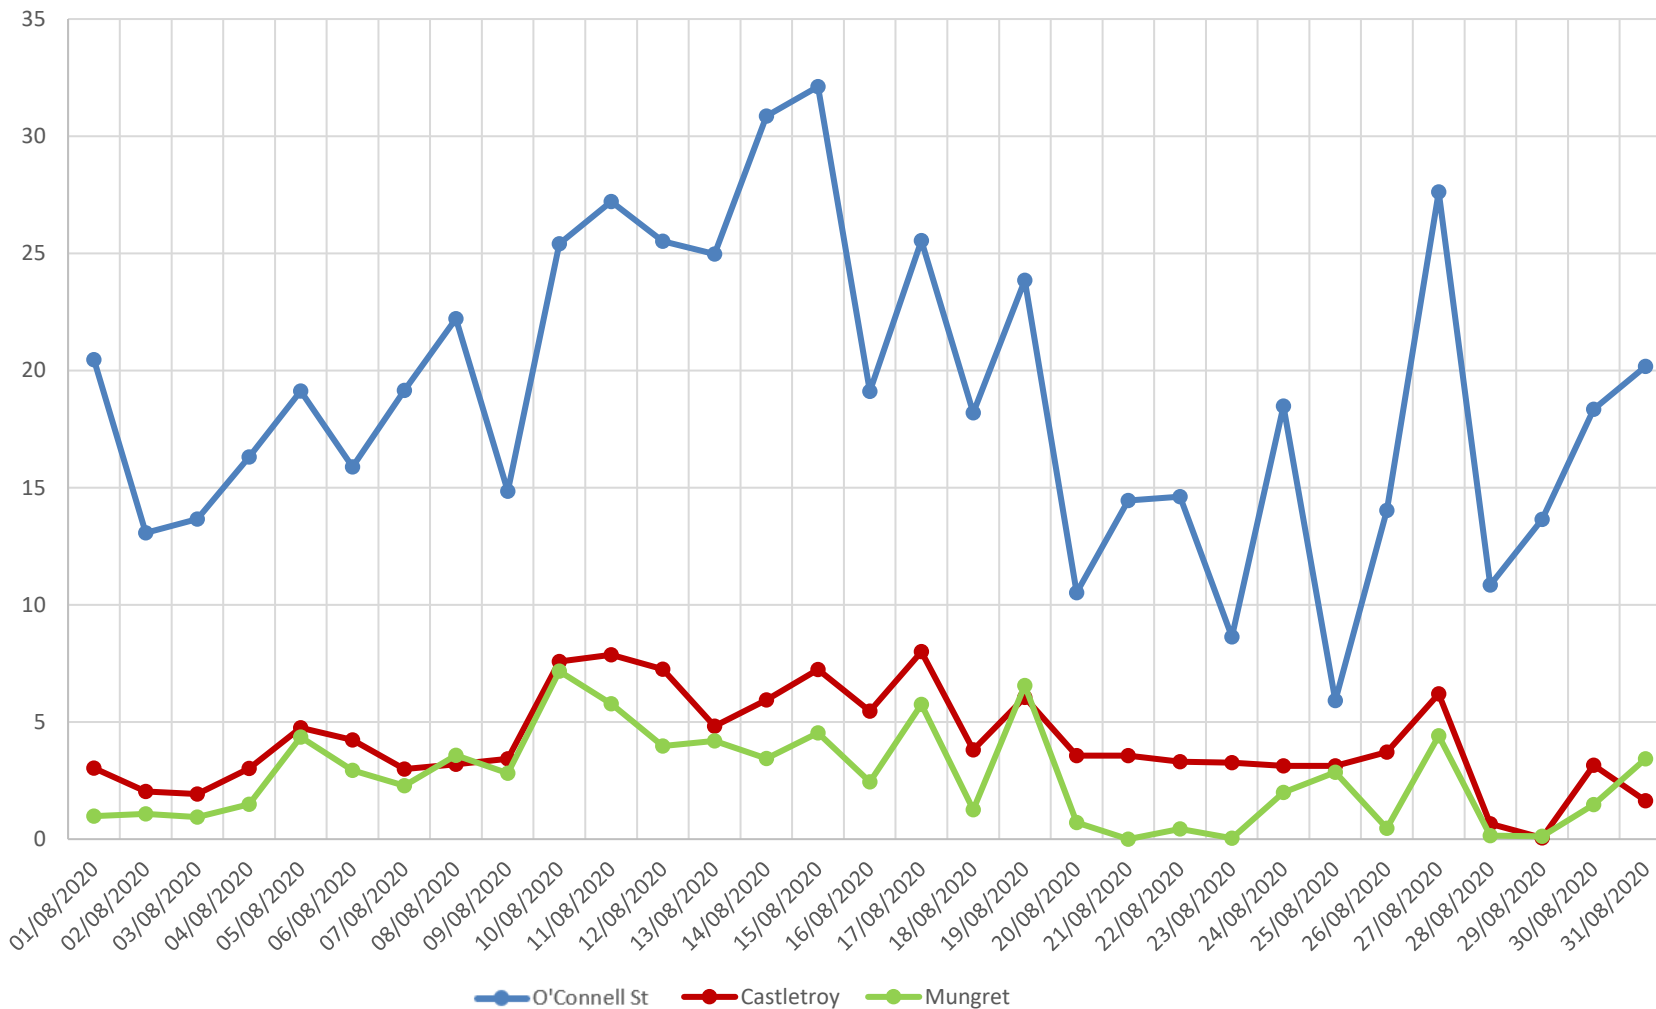

SO₂ - 24 hour mean (µg/m³)

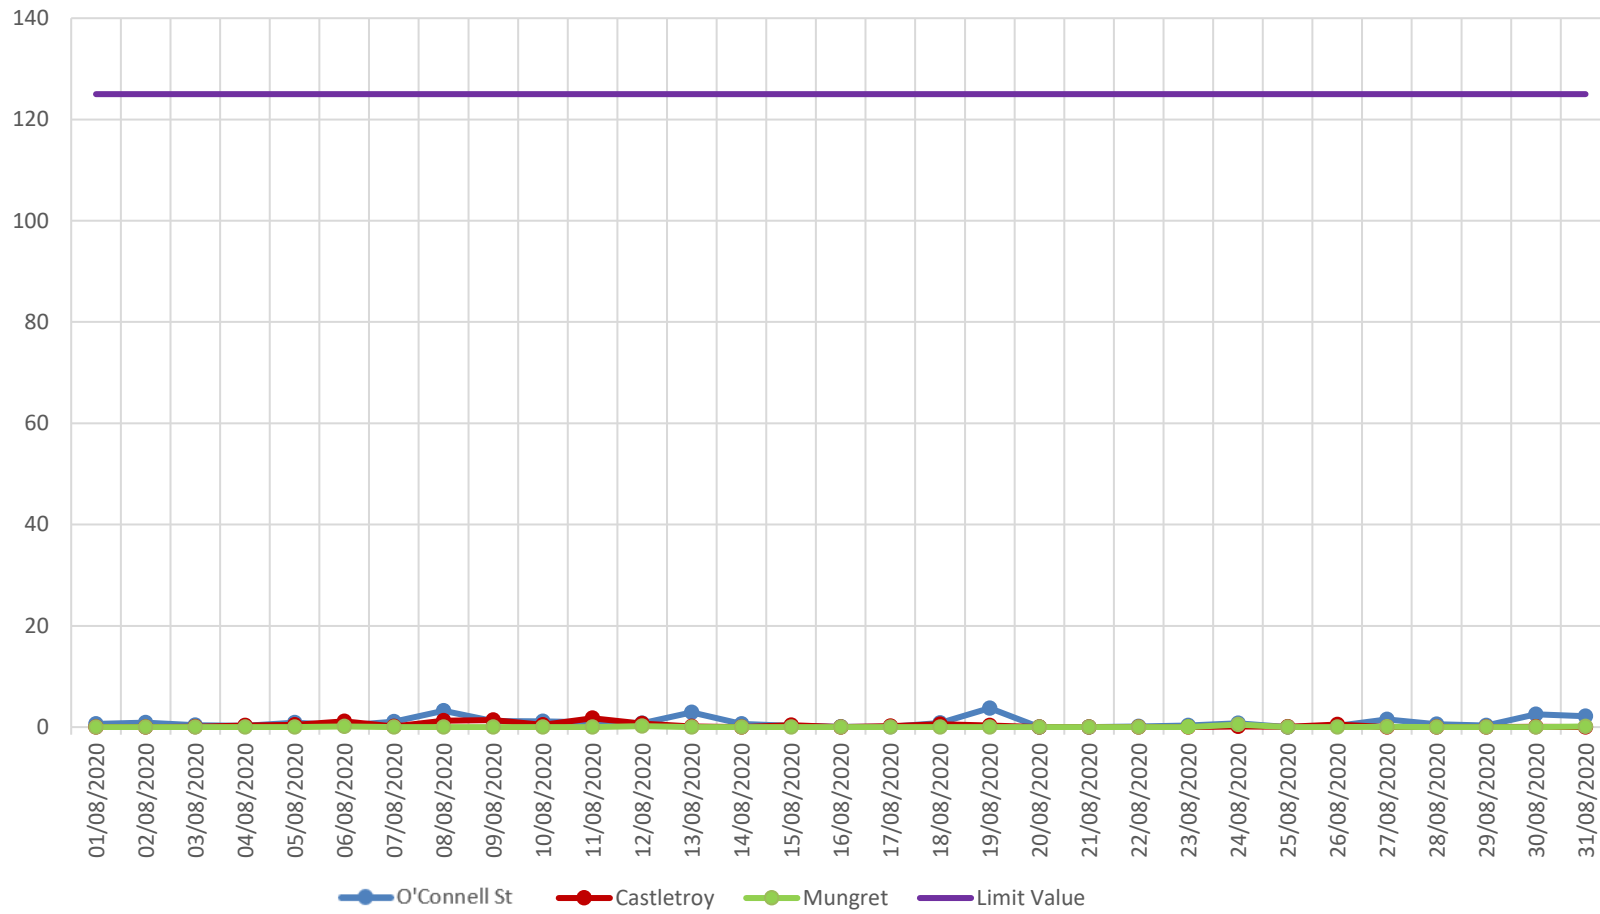

CO - 24 hour mean (mg/m³)

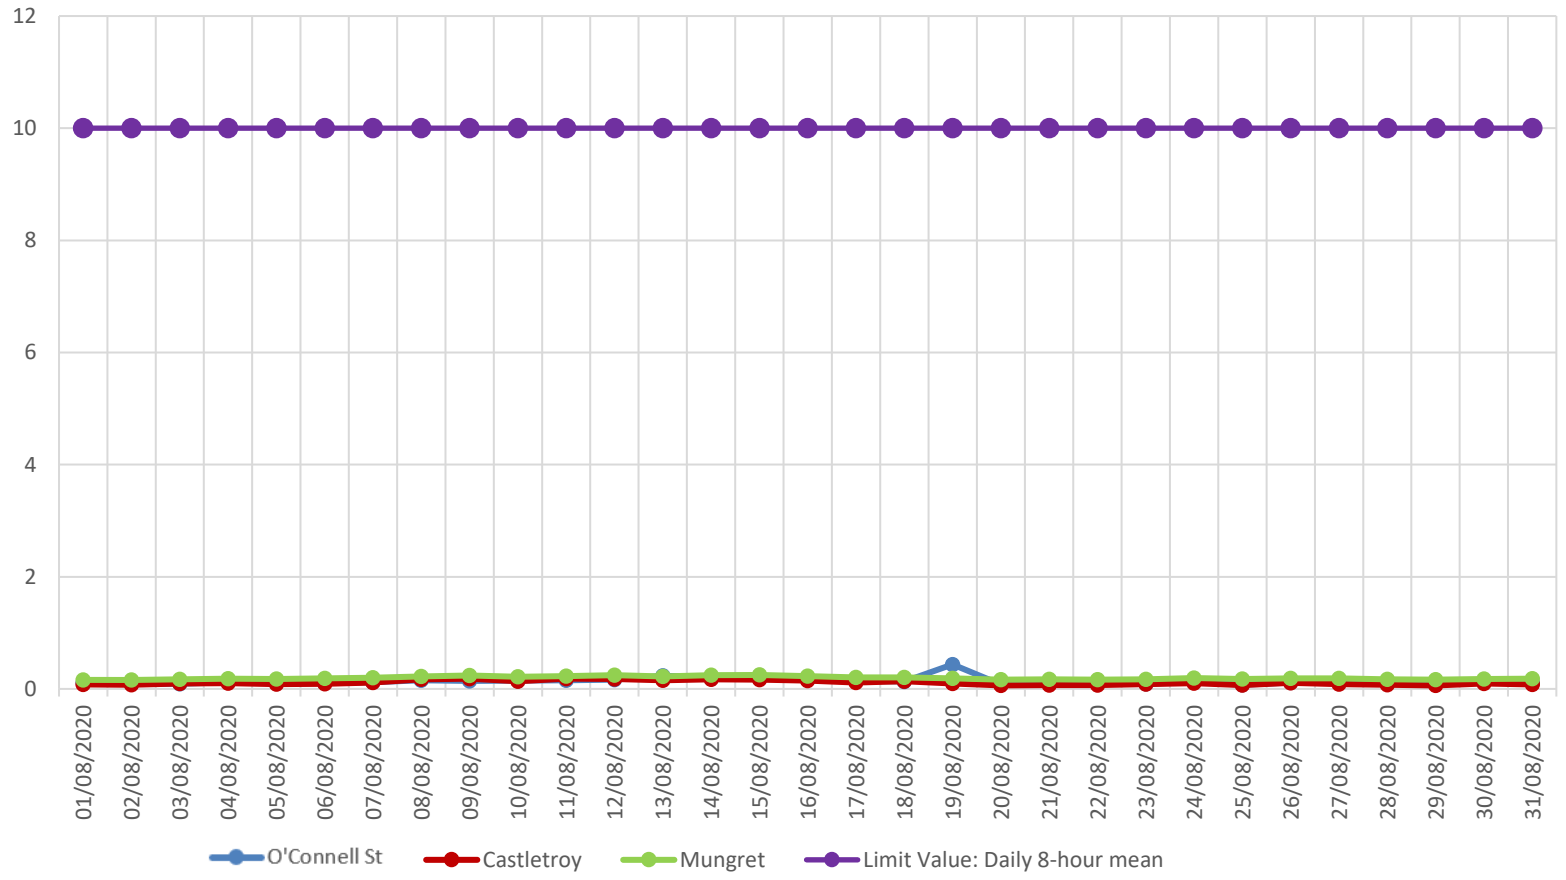

Ozone - 24 hour mean (ug/m³)

